

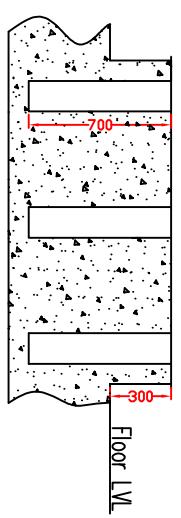
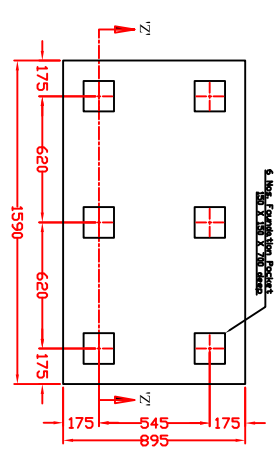
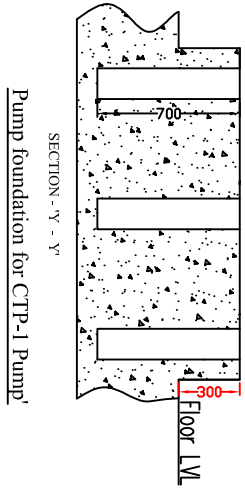
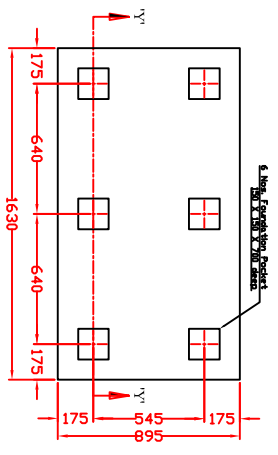
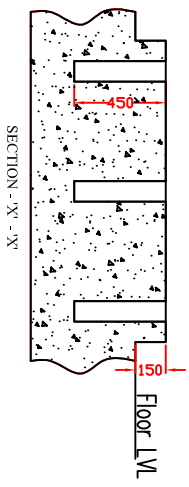


EXISTING FOUNDATION FOR PUMPS, CHILLER & CT OF SST1 WCS PLANT


FOUNDATION DETAIL

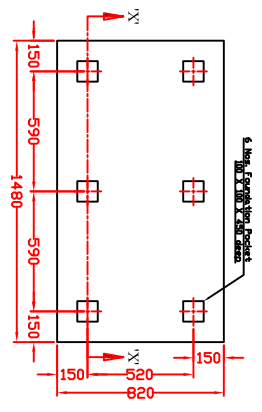

Pump foundation for CTP-2 Pump

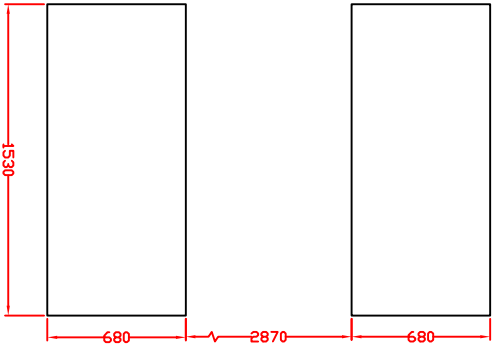

Chiller Foundation
Height: 180 mm from Floor Level

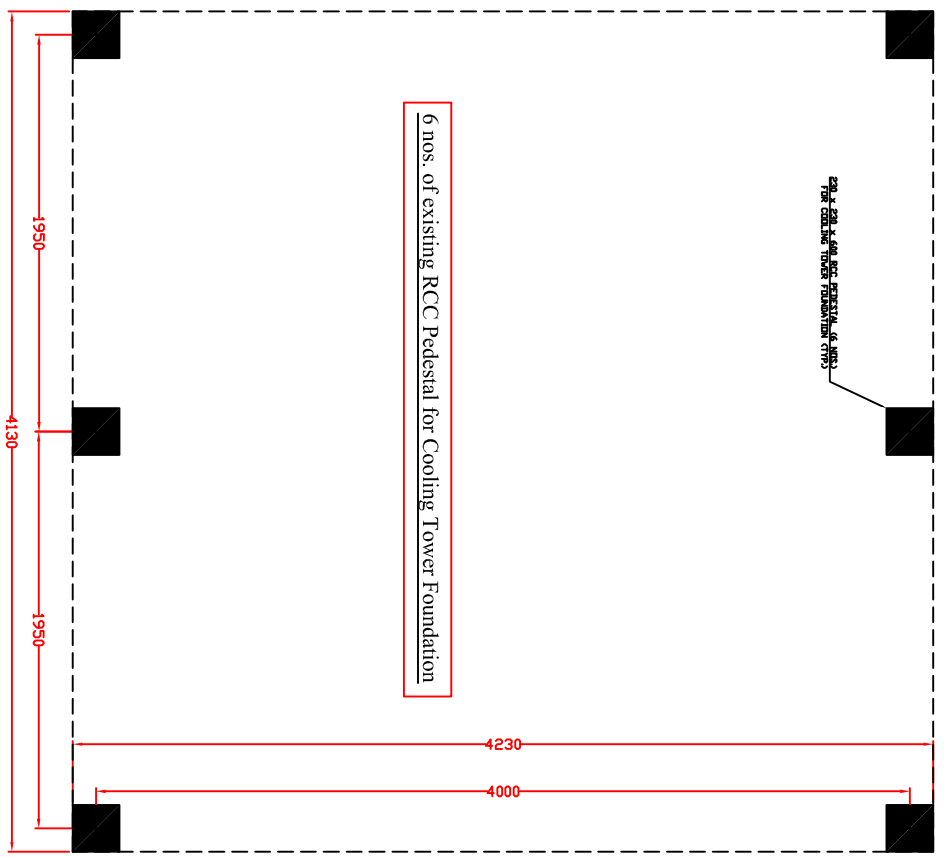

6 nos. of existing RCC Pedestal for Cooling Tower Foundation

Existing 500 NB inlet/ outlet pipes header.

NO/NO	DATE	BY	CHKD	REV	ZONE	DESCRIPTION	DATE	REVISION	APPROVED BY	DATE	REVISION	APPROVED BY	DATE	REVISION	APPROVED BY
01	15/08/2023

INSTITUTE FOR PLASMA RESEARCH
TITLE: EXISTING FOUNDATION DETAILS FOR PUMPS, CHILLER & CT OF SST1 WCS PLANT
REV: 01 OF 01